



Žr. Lapą Nr. 3

Oper. medium	Benzinas (stabilus katalizatas)	GOST Category	B6 -II	Parameters	Oper. pressure	bar	22,5	Vamzdynas Nr. :/Pipe line Nr.:/ V.210/2	Baras:/ Section:/ GP-Nr.1-LK2			
		PED Category	1-III		Design pressure		22,5					
Test medium	vanduo	Material	20		Test pressure	33	Nou S-212, S-213 iki KR-204			Lapas Page	Lapų Pages	
Codes	PJ.38.13.004-86	Insulation	YES		Oper. temp.	°C				240	3	3
Calc. No.	-----	PWHT	NO		Design temp.					250		
R.Golebiewski	-----	Heating	NO		Test temp.	5÷40						

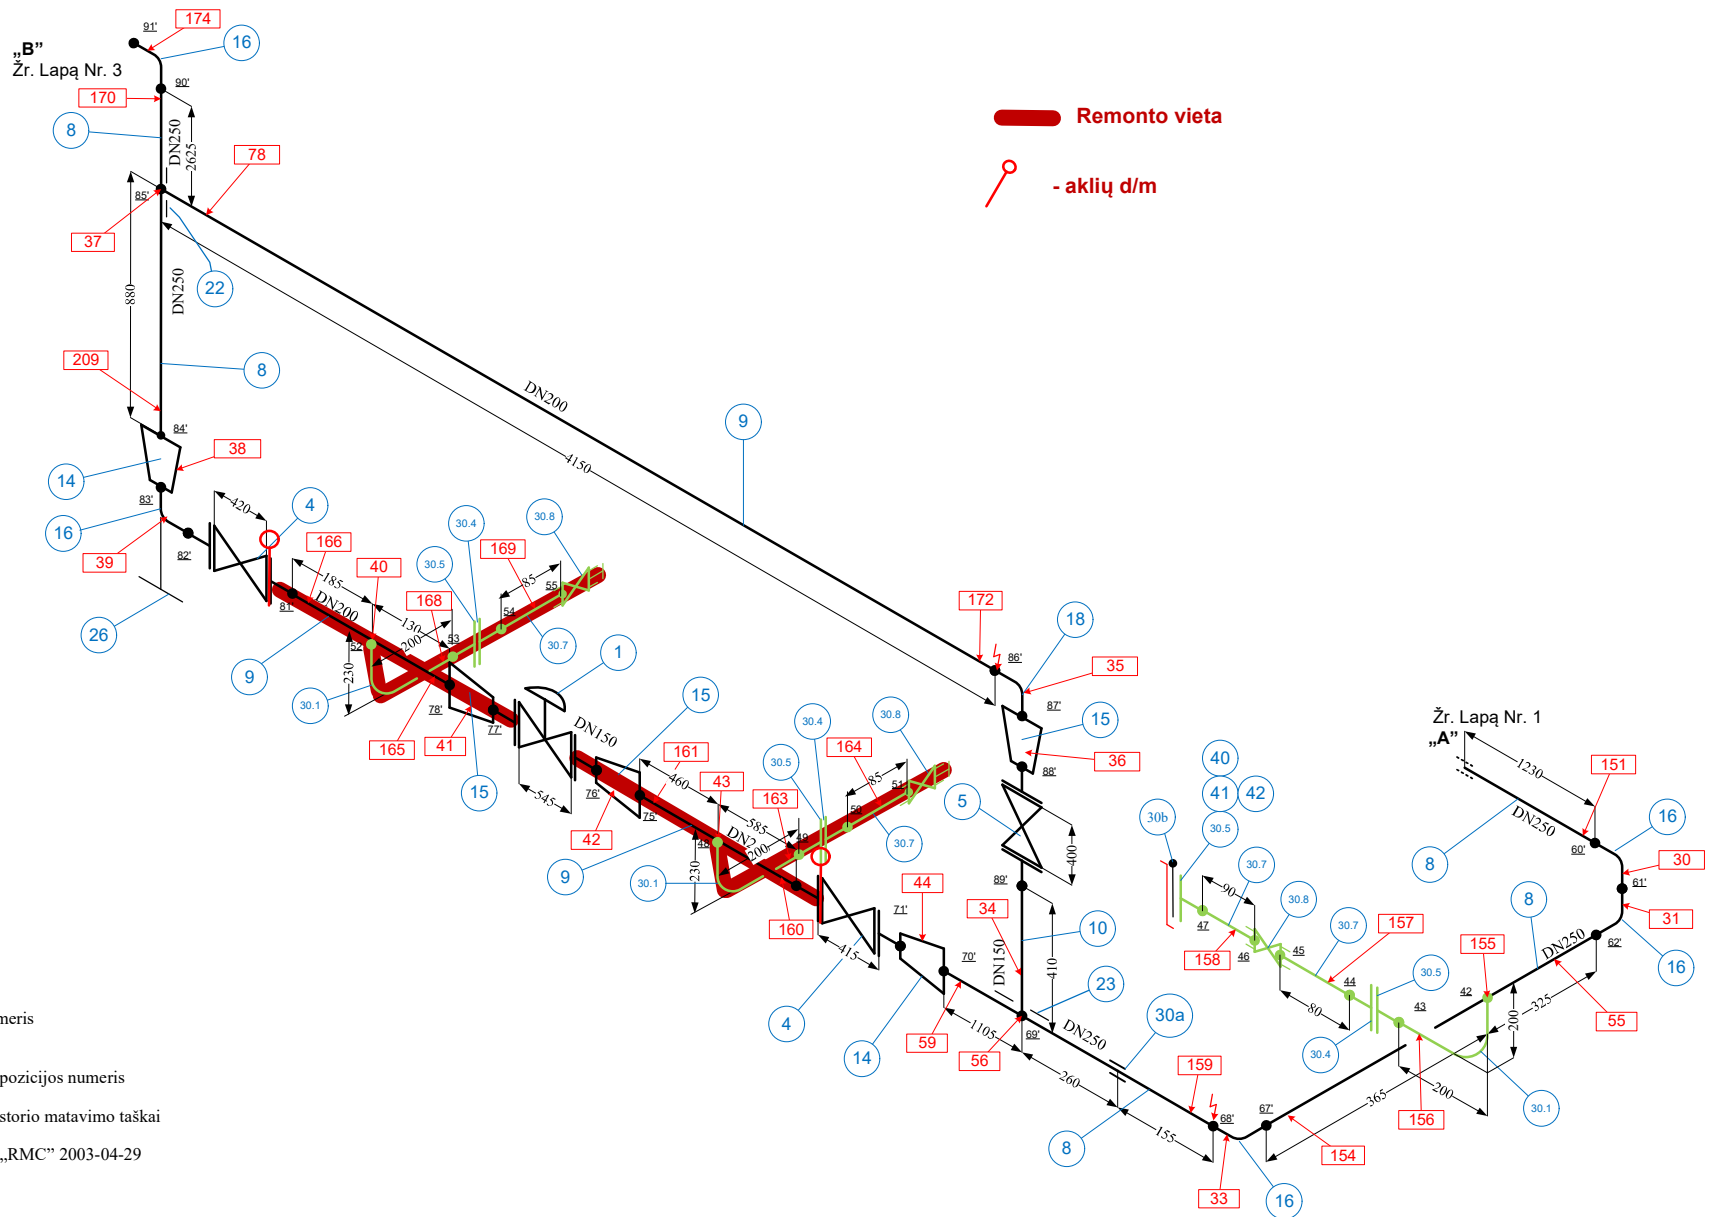

	Oper. medium	Benzinas (stabilus katalizatas)	GOST Category	B6 -II	Parameters	Oper. pressure	bar	22,5	Vamzdynas Nr. :/Pipe line Nr.:/ V.210/2	Baras:/ Section:/ GP-Nr.1-LK2		
			PED Category	1-III		Design pressure		22,5				
						Test pressure		33				
	Test medium	vanduo	Material	20			°C	240	Nou S-212, S-213 iki KR-204		Lapas Page	Lapų Pages
	Codes	PD.38.13.004-86	Insulation	YES		Oper. temp.		250				
	Calc. No.	-----	PWHT	NO		Design temp.		5÷40				
	R.Golebiewski	-----	Heating	NO		Test temp.						