


Oper. medium	vanduo	GOST Category (BM-4)	1b	Parameters	Oper. presure	bar	217,7	Vamzdynas Nr. :/Pipe line Nr.:/ K-3 MV 356	Baras:/ Section:/ ŠE, EŠEGĮ		
		PED Category	2-III		Design presure		217,7				
Test medium		Material	15ГC		Test presure		317,5				
Codes	CH и П III.Г.9-62	Insulation	yra		Oper. Temp.	°C	255	nuo vamzd. Nr. T-3 MV 372; K-3,4 MV 400 iki vamzdyno į K-2	Lapas Page	Lapų Pages	
Tikrino		PWHT			Design Temp.		255		2	3	
Braižė	Andrius Vaseris	Heating	nėra		Test Temp.		10÷40				

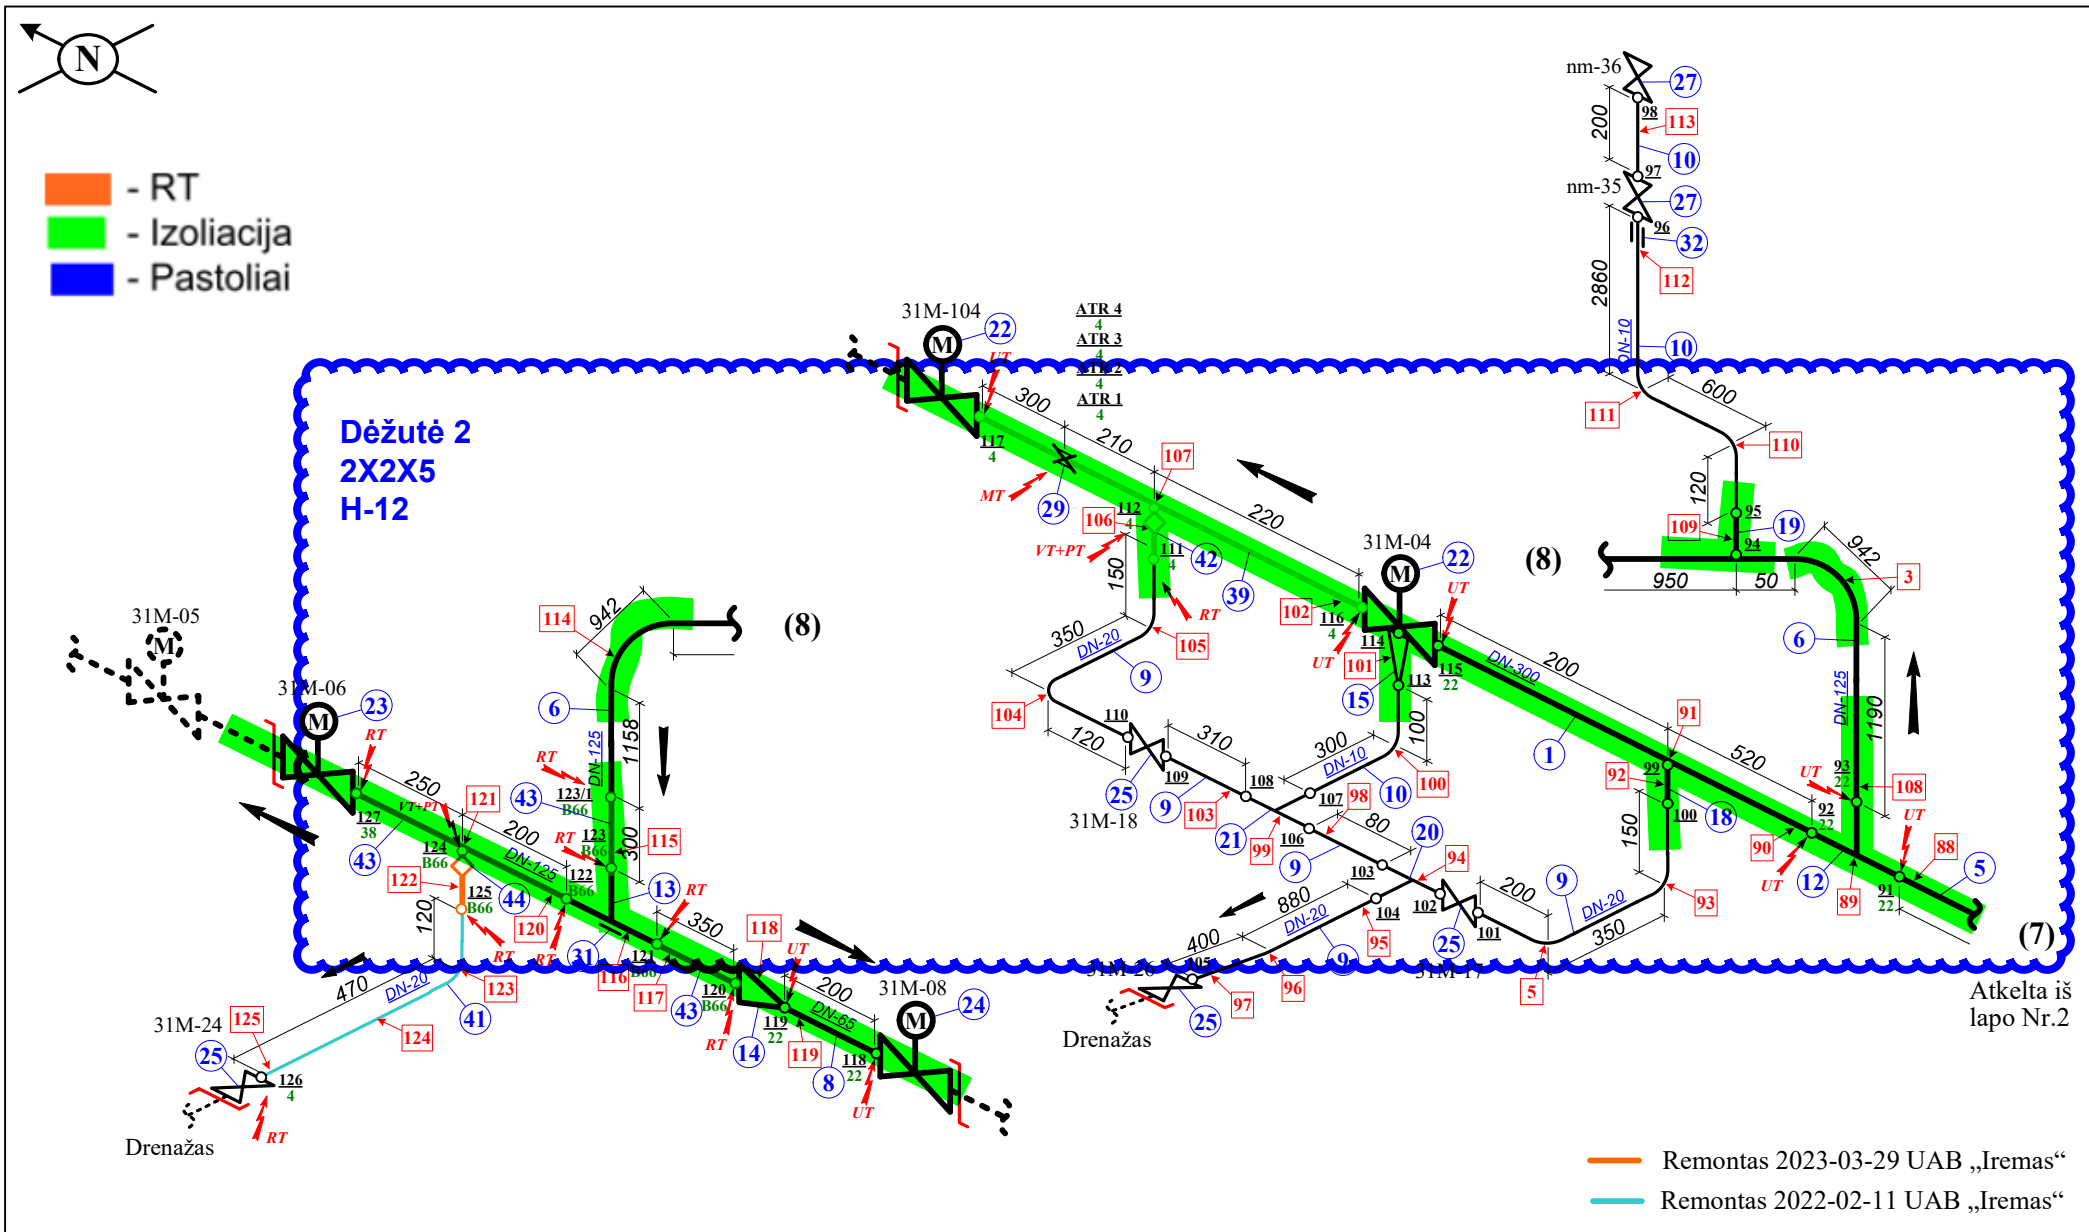

Oper. medium	vanduo	GOST Category (BM-4)	1b	Parameters	Oper. pressure	bar	217,7	Vamzdinas Nr. :/Pipe line Nr.:/		Baras:/ Section:/	
		PED Category	2-III		Design pressure	bar	217,7	K-3 MV 356		ŠE, EŠGĮ	
Test medium		Material	15ГC		Test pressure		317,5	nuo vamzd. Nr. T-3 MV 372; K-3,4 MV 400 iki vamzdino į K-2		Lapas	Lapų
Codes	CH и II III.Г.9-62	Insulation	yra		Oper. Temp.	°C	255			Page	Pages
Tikrino		PWHT			Design Temp.		255			3	3
Braižė	Andrius Vaseris	Heating	nėra		Test Temp.		10÷40				