




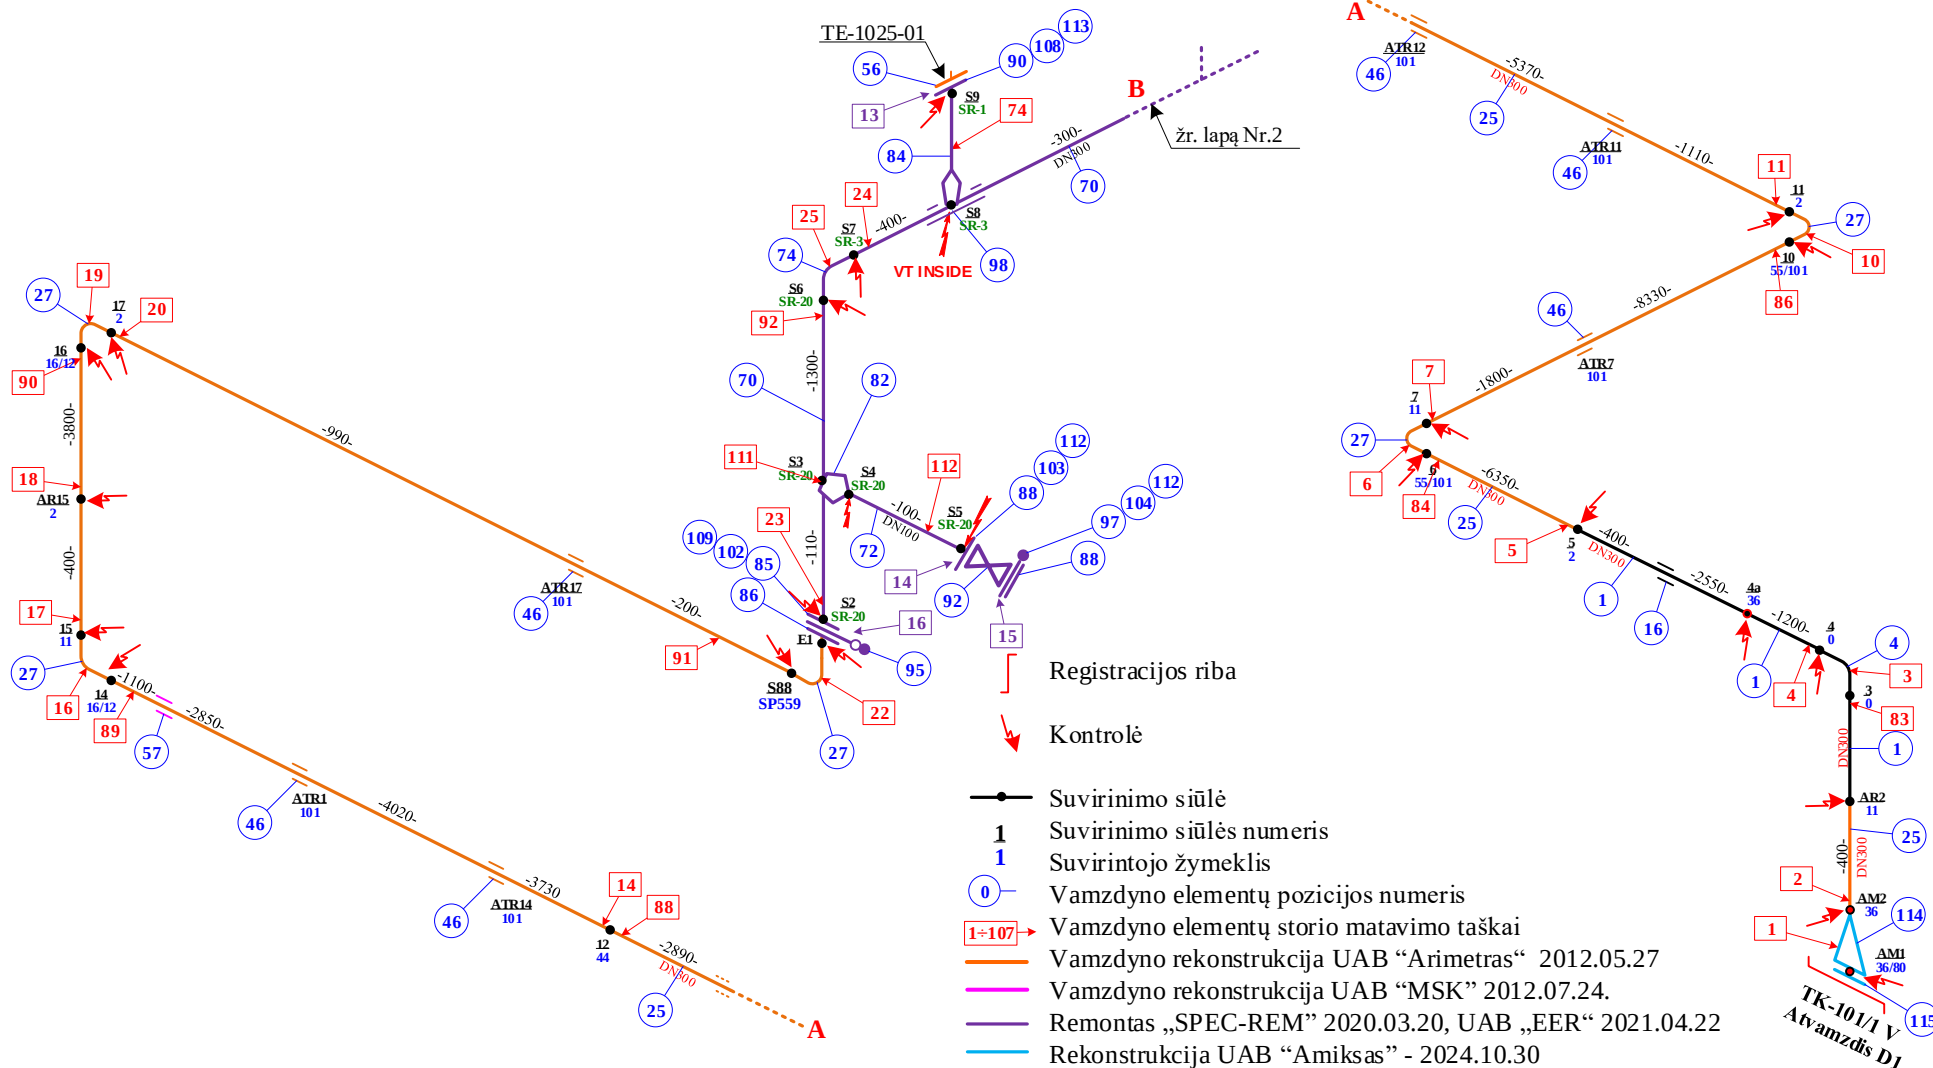

Oper. medium	VD ir vak. distiliato mišinys	GOST Category (BM-4)	Ba I (1-III)	Parameters	Oper. pressure	bar	61	Vamzdynas Nr. :/Pipe line Nr.:/ V.102/3	Baras:/ Section:/ GP-Nr.2 Įrenginys Nr.2 (S-100)			
		PED Category	1-III		Desing pressure		64					
Test medium	vanduo	Material	15x5M;P5; TP321		Test pressure		111,2					
Codes	PDI 38.13.004-86	Insulation	YES		Oper. Temp.	°C	380	Iš šilumokačio TK-101/1 į krosnį Kr-101.			Lapas	Lapų
Calc. No.	---	PWHT	YES		Desing Temp.		400				Page	Pages
---	---	Heating	NO		Test Temp.		10÷40				1	3



Oper. medium	VD ir vak. distiliato mišinys	GOST Category (BM-4)	Ba I (1-III)	Parameters	Oper. presure	bar	61	Vamzdynas Nr. ./Pipe line Nr.:/ V.102/3	Baras./ Section:/ GP-Nr.2 Įrenginys Nr.2 (S-100)		
		PED Category	1-III		Desing presure		64				
Test medium	vanduo	Material	15x5M;P5,TP321		Test presure		146				
Codes	ПД 38.13.004-86	Insulation	YES		Oper. Temp.	°C	380	Iš šilumokačio TK-101/1 į krosnį Kr-101.	Lapas Page	Lapas Pages	
Calc. No.	---	PWHT	YES		Desing Temp.		400		2	3	
---	---	Heating	NO		Test Temp.		10÷40				

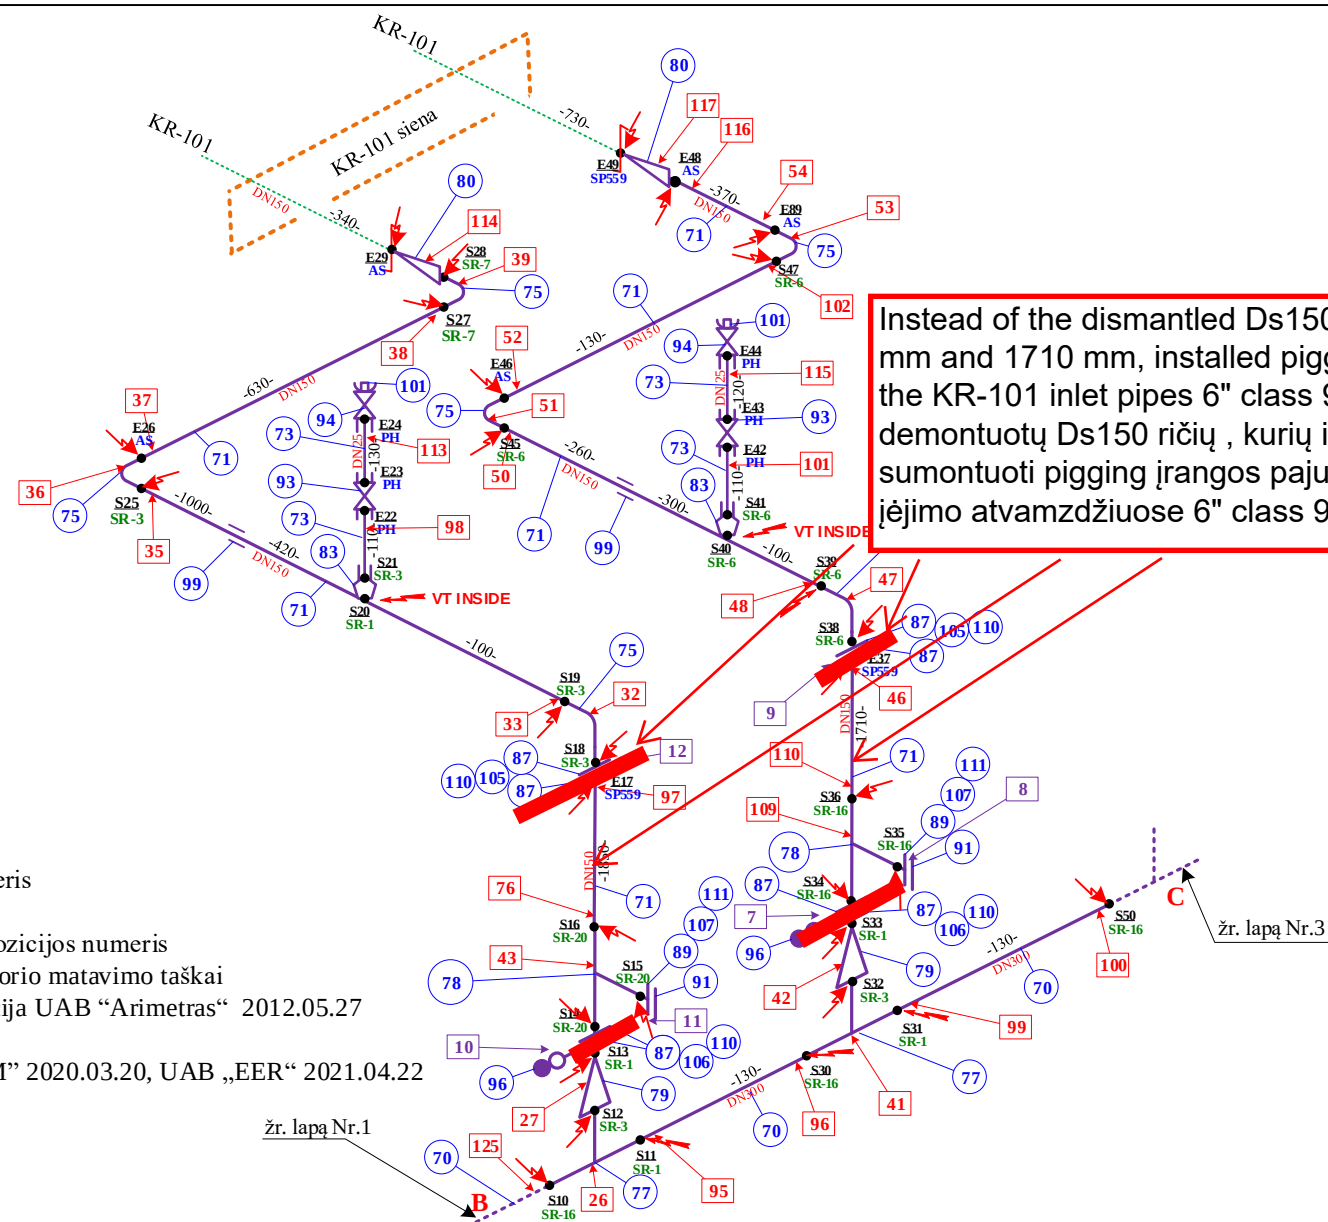