
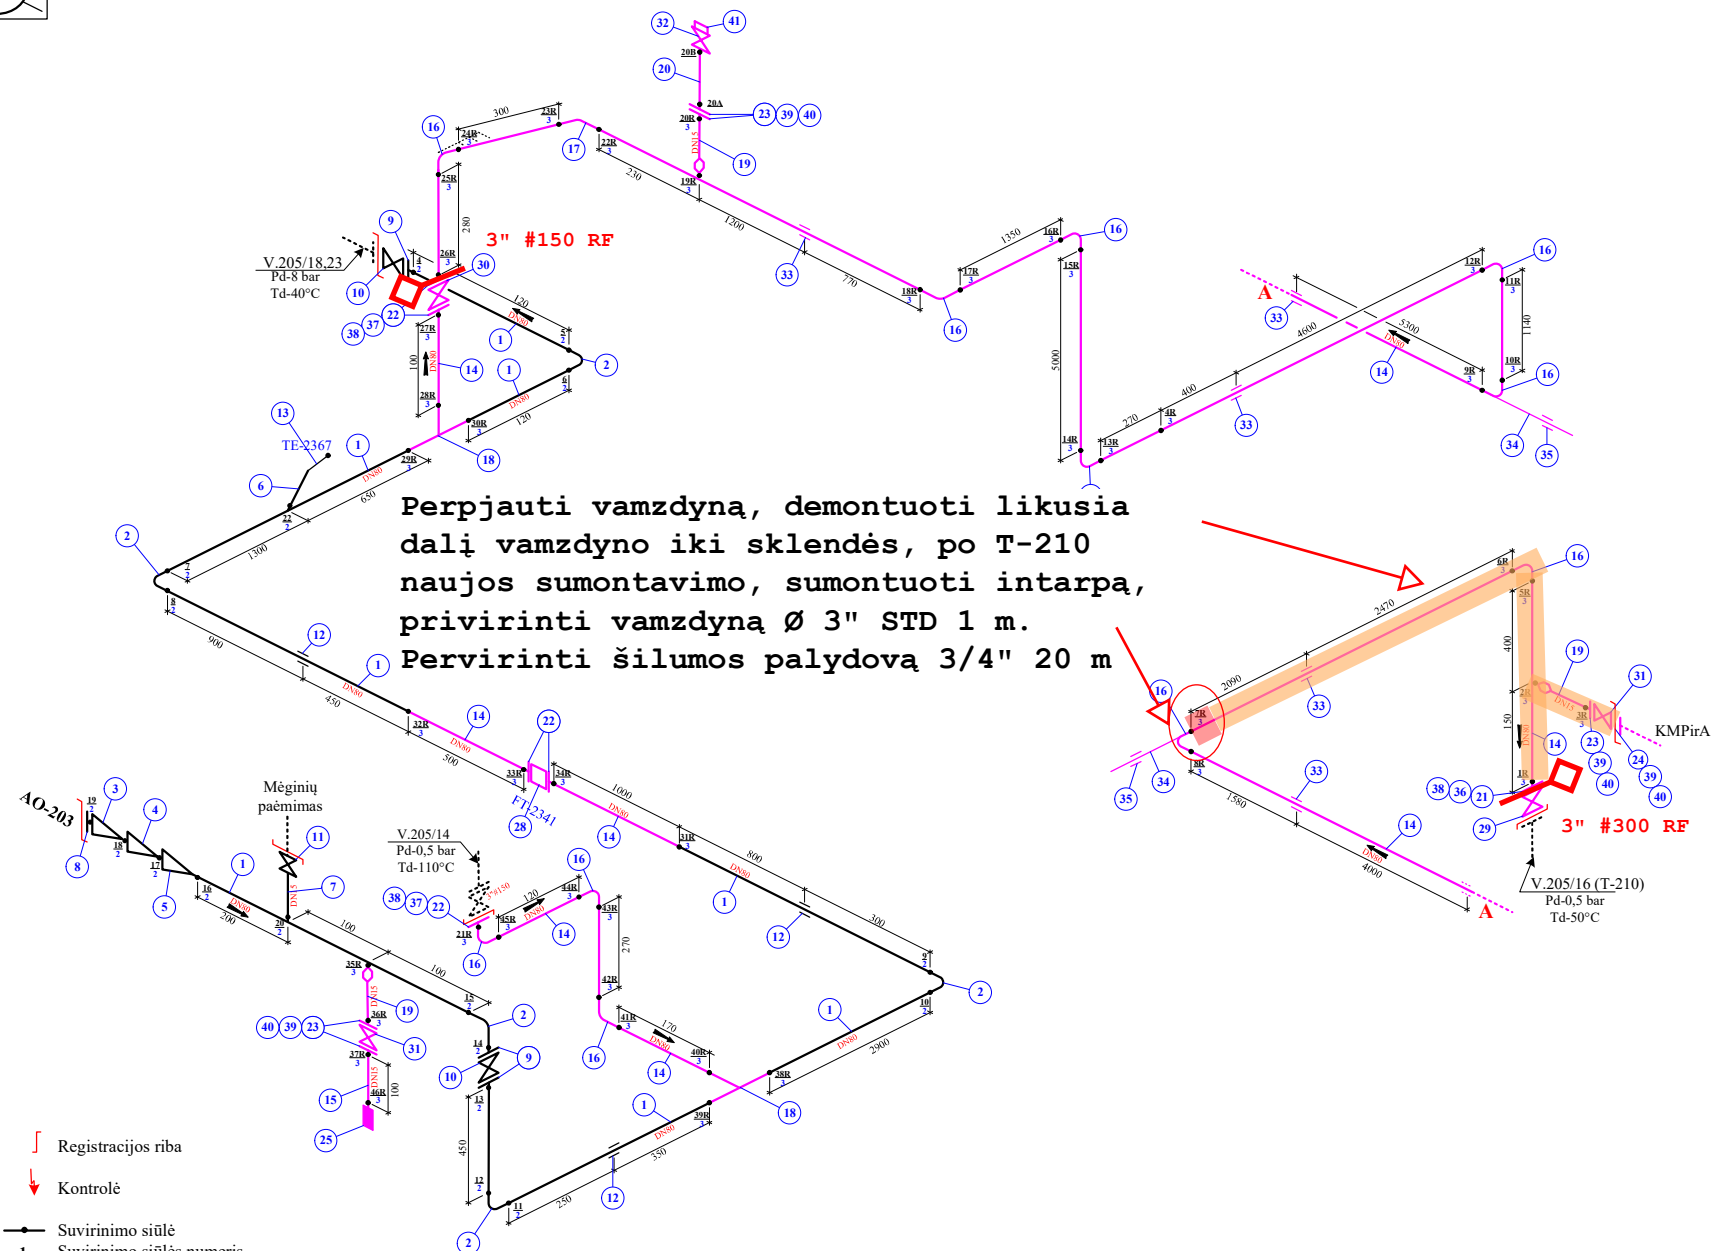


Suvirinimo siūlėm atlikti terminį apdirbimą.



Oper. medium	Tech. Kondensatas H ₂ S-0; NH ₃ -0,1%	GOST Category (BM-4)	Aa I (I-II)	Oper. pressure	bar	0,5	Vamzdynas Nr. /Pipe line Nr.:/	Baras/ Section:/
Test medium	vanduo	PED Category	--	Design pressure	bar	16,0	V.205/5	GP-Nr.2 Įrenginys Nr.3 (S-200)
Codes	P/D 38.13.004-86	Material	20	Test pressure	bar	23,0	Is orimo aušintuvo AO-203 į V.205/16 (T-210) ir V.205/18.23.	Lapas
Calc. No.	----	Insulation	YES	Oper. Temp.	°C	50		Page
----	----	PWHT	YES	Desing Temp.	°C	100		Pages
----	----	Heating	YES	Test Temp.	°C	10÷40		1