



High-pressure pipeline flushing.

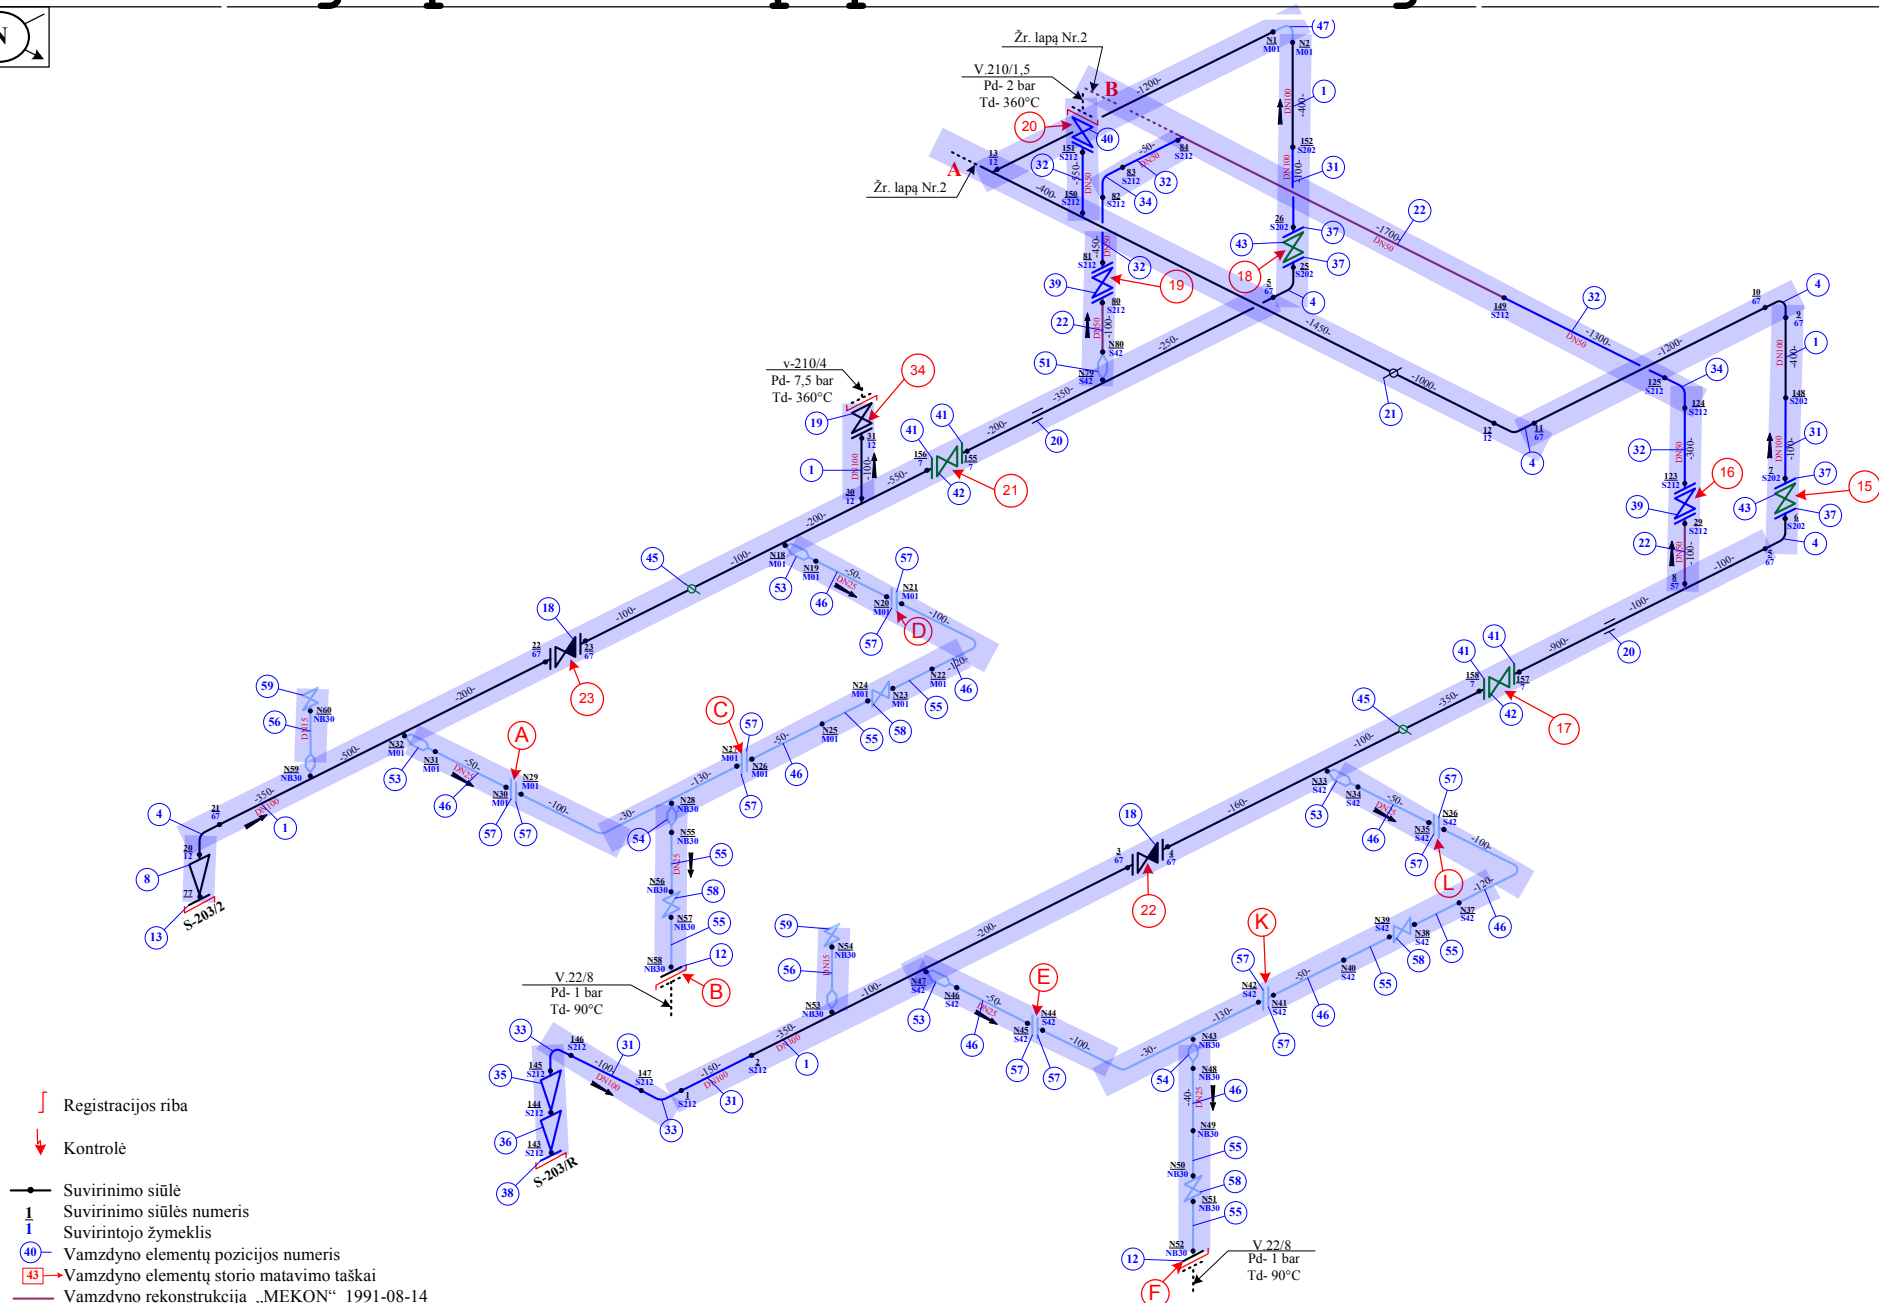

Oper. medium	šlamos (fr >420°C)	GOST Category (BM-4)	Бв II (1-II)	Oper. pressure	bar	23,0	Vamzdynas Nr. /Pipe line Nr.:/		Baras/ Section:/	
Test medium	vanduo	PED Category	--	Design pressure	bar	23,0	V.210/2,3,8		GP-Nr.2 Įrenginys Nr.3 (S-200)	
Codes	P/D 38.13.004-86	Material	20	Test pressure	bar	28,0	Iš siurblių S-203/1,2,R į talpą T-201, koloną K-201, v.210/1,5, v.210/6,7.		Lapas	Lapų
Calc. No.	----	Insulation	YES	Oper. Temp.	°C	360			Page	Pages
----	----	PWHT	NO	Desing Temp.	°C	360			1	2
----	----	Heating	YES	Test Temp.	°C	10~40				

High-pressure pipeline flushing.

