



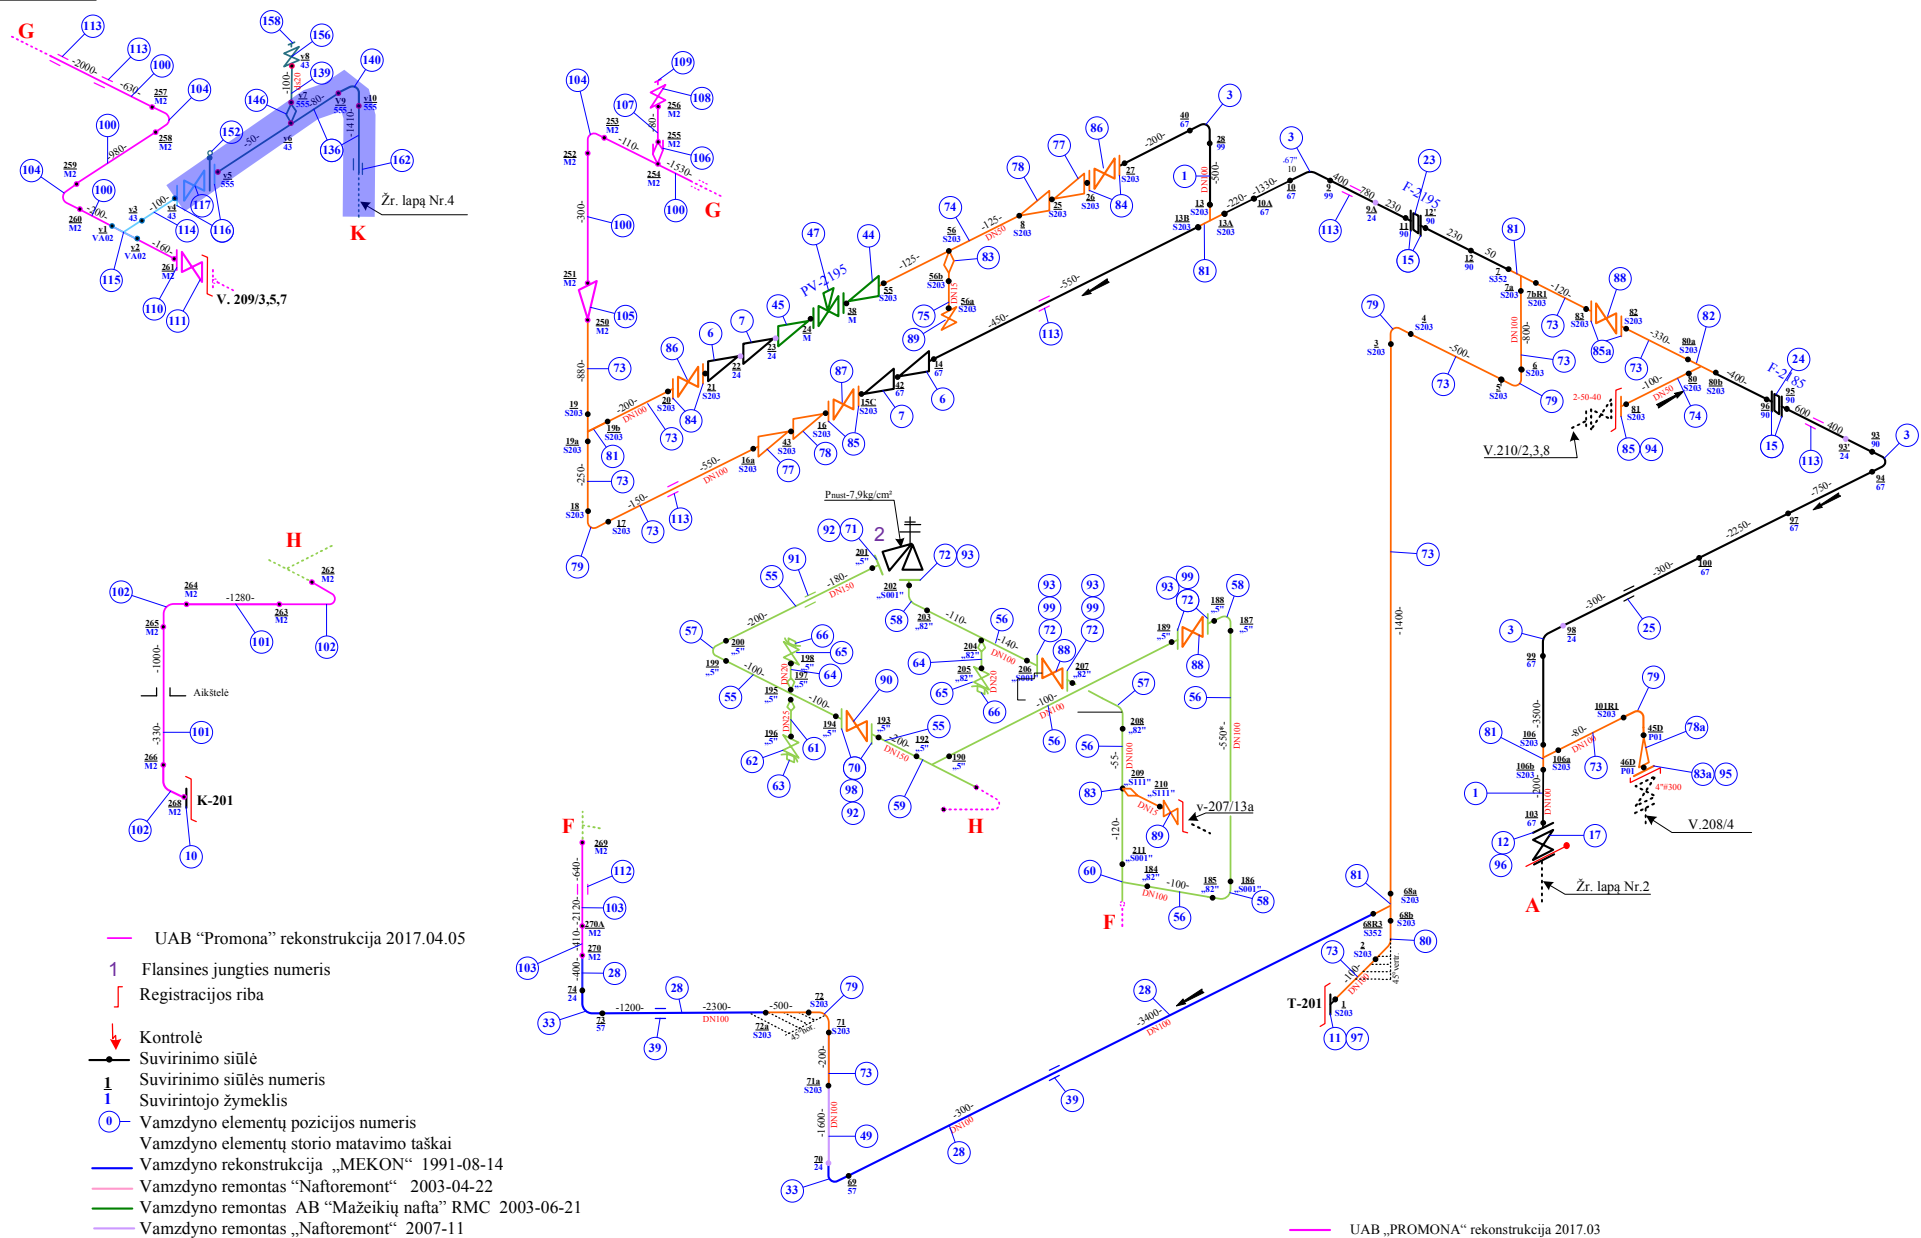

Oper. medium	dekantatas (fr >420°C)	GOST Category (BM-4) PED Category	Бв I (I-II) --	Parameters	Oper. pressure	bar	8,0	Vamždynas Nr. /Pipe line Nr./ V.210/6,7	Baras:/ Section/ GP-Nr.2 Įrenginys Nr.3 (S-200)	
Test medium	vanduo	Material	20		Design pressure		10,0			
Codes	P/D 38.13.004-86	Insulation	YES		Test pressure		19,0			
Calc. No.	----	PWHT	NO		Oper. Temp.		370			
----	----	Heating	YES		Dising Temp.	°C	370			
----	----				Test Temp.		10÷40			
								Iš talpos T-201 į koloną K-201 , v.208/4 (TK-204) ir S-001.	Lapas Page	Lapas Page
								1	2	



Oper. medium	dekantatas (fr >420°C)	GOST Category (BM-4)	Bb I (I-II)	Parameters	Oper. presure	8,0	Vamdynas Nr. /Pipe line Nr./ V.210/6,7	Baras:/ Section/ GP-Nr.2 [renginys Nr.3 (S-200)]			
		PED Category	--		Design presure	10,0					
Test medium	vanduo	Material	20		Test presure	19,0					
Codes	РД 38.13.004-86	Insulation	YES		Oper. Temp.	370					
Calc. No.	----	PWHT	NO		Desing Temp.	370					
----	----	Heating	YES		Test Temp.	10÷40					
						°C	Iš talpos T-201 į koloną K-201 , v.208/4 (TK-204) ir S-001.			Lapas Page	Lapu Pages
									2	2	